


DEA SYSTEM s.r.l.
Via Monte Summano 45/E , 36010 Zanè
(VI) - Italy
Tel.+39.0445.314944 Fax +39.0445.314334
<http://www.deasystem.com>
e-mail: deasystem@deasystem.com

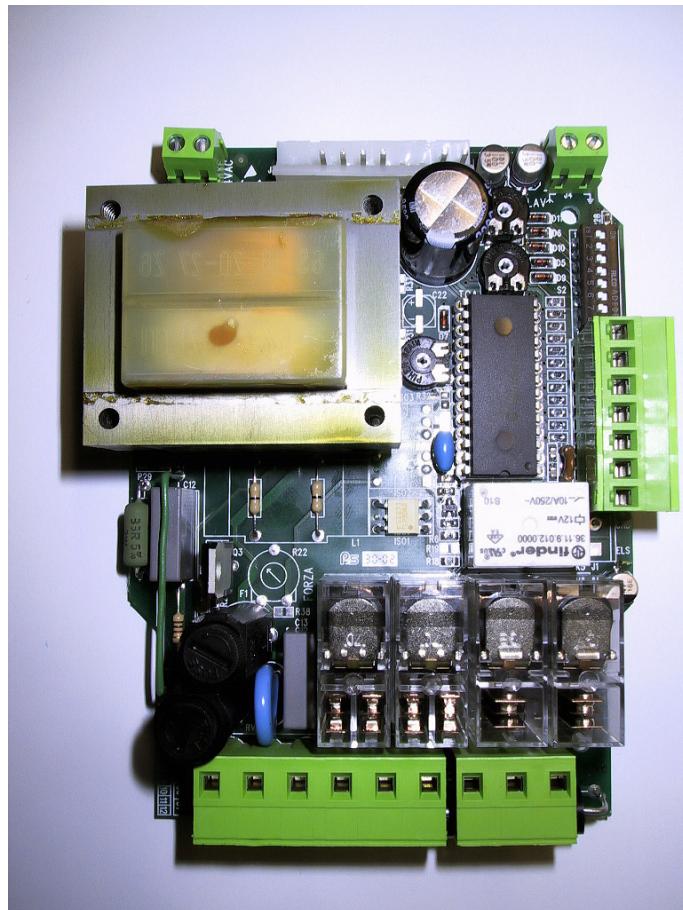

203B_2

I	CENTRALE DI COMANDO
F	UNITÉ DE COMMANDE
GB	CONTROL UNIT
E	CENTRAL DE MANDO
P	QUADRO DE COMANDO

ISTRUZIONI D' USO E DI INSTALLAZIONE
INSTRUCTIONS D'UTILISATION ET D'INSTALLATION
INSTALLATION AND USER'S MANUAL
INSTRUCCIONES DE USO Y DE INSTALACION
INSTRUÇÕES DE USO E DE INSTALAÇÃO

Document Number	F12031
Rev	01
Date	17/12/02
filename	F1203101.pub

203B_2



GB

This booklet is an integral and essential part of the product and must be delivered to the user. Carefully read the warnings contained inside that provide important information regarding safety during installation, use and maintenance.

OVERVIEW

The DEA 203B_2 control panel has been designed to control the "DEA SYSTEM" automation devices for both sliding gates powered by 230V single-phase motors, and comes complete with an inertia limitation system. The widest versatility, easy installation and complete respect for the European regulations in force regarding electromagnetic compatibility and electric safety are the unit's main characteristics; in particular, DEA SYSTEM ensures conformity to the following European Directives: 89/336/EEC, 73/23/EEC and subsequent amendments.

DEA SYSTEM reminds all users that the selection, configuration and installation of all the devices and materials in the entire automation must be performed in respect of the regulations in force in the nation of installation.

TECHNICAL DATA

Power supply	:230V AC +/- 10% 50 Hz
Flashing light output	230V AC 50 Hz max 40W
Gate open signal light/courtesy light output	:230V AC 50 Hz max 40W
Auxiliary power supply output	:24V AC max 200 mA
Electric lock output	:12V AC max 15V A
Max. motor power	:500W
Fuse F1	:160 mA 250V
Fuse F2	:5A 250V
Max pause time	:80 s
Max work time	:160 s

The work time you set must anyway allow to respect the maximum working time admitted for the type of motor you are using. Please refer to the data on the motor label.

ELECTRICAL SYSTEM CONFIGURATION (See fig. 1)

IMPORTANT: Any installation, maintenance, cleaning or repair operations on any part of the automatism must be performed exclusively by qualified personnel, and all such operations must be performed only after first disconnecting the power supply. Always keep the 230V cables (power supply, motor, starting condenser, flashing light, courtesy light) separate from the low voltage cables (controls, electric lock, antenna, and auxiliary power supply) and fasten these latter using adequate clamps near the terminal boards. Install a multiple pole switch with a contact opening of 3 mm provided with protection against overloads upstream from the automatism. Use a cable with a minimum section of 3X1.5 mm² (such as H07RN-F type) for the power supply and scrupulously respect all the regulations in force regarding electrical systems in the nation of installation.

TERMINAL BOARD CONNECTION:

(See fig. 1)

- 1-2: Power supply: 230V AC +/-10% 50 Hz (F = phase, N = neutral)
- 3-4: Courtesy light output 230 V AC 50 Hz max 40W (DIP8 = ON)
- 5-6: Gate open indicator light output: 230 V AC 50 Hz max 40W (DIP8 = OFF)
- 7-8-9: Flashing light output: 230 V AC 50 Hz max 40W

- 12: Common inputs
- 13: FCA opening limit-switch input (N.C.) stops the motor's opening stroke
- 14: FCC closing limit-switch input (N.C.) stops the motor's closing stroke
- 15: APRE PEDONALE opens the gate to a width of only 1.5 (N.O.)
- 16: FOTO Photocell Art. 104/105 input (N.C.) inverts movement during closing, and if enabled during opening stops movement
- 17: STOP stop button input (N.C.) stops movement in any situation
- 18: APRE open/close button input (N.O.) can function in both step-by-step mode and inversion mode

IMPORTANT: All N.C. inputs not used must be bridged towards the common inputs terminal.

- 19: Antenna ground
- 20: Antenna signal
- 21-22: Auxiliary power supply output: 24V AC max 200mA
- J3: Radio receiver plug-in connector

OPERATION:


TIME SETTING

- TCA: trimmer for the setting of the automatic closing time, after which the gate will automatically close again.
- TLAV: trimmer for the setting of the work time, after which the motor will stop during both opening and closing.
Whenever the limit-switches are installed, the work time must be set to a value that is a few seconds higher than the real time required for the stroke of the motor.

DIP-SWITCHES FUNCTIONS		
DIP1	ON	"collectivity" function enabled: does not receive opening pulses during opening and the gate open pause time
	OFF	"collectivity" function disabled: receives opening pulses also during opening and the gate open pause time
DIP2	ON	Not used
	OFF	Not used
DIP3	ON	"step-by-step" program: OPEN->opening, OPEN->stop, OPEN->closing...
	OFF	"inversion" program: OPEN->opening, OPEN->closing, OPEN->opening...
DIP4	ON	Not used
	OFF	Not used
DIP5	ON	Photocell operative also during opening: stops all movement until the obstacle is removed
	OFF	Photocell operative only during closing: inverts direction of movement
DIP6	ON	automatic closing disabled: after opening, it closes again only after an opening pulse
	OFF	automatic closing enabled : after opening, and after the pause time set, the gate automatically closes again
DIP7	ON	Not used
	OFF	Not used
DIP8	ON	Terminals 3-4: courtesy light output 230V AC 50 Hz (delay: 50 seconds)
	OFF	Terminals 3-4: gate open signal light output, 230V AC, 50 Hz

It is in any case obligatory to use appropriate safety devices in order to ensure the impact force limitation values prescribed by the regulations in force in the nation of installation.

fig. 1

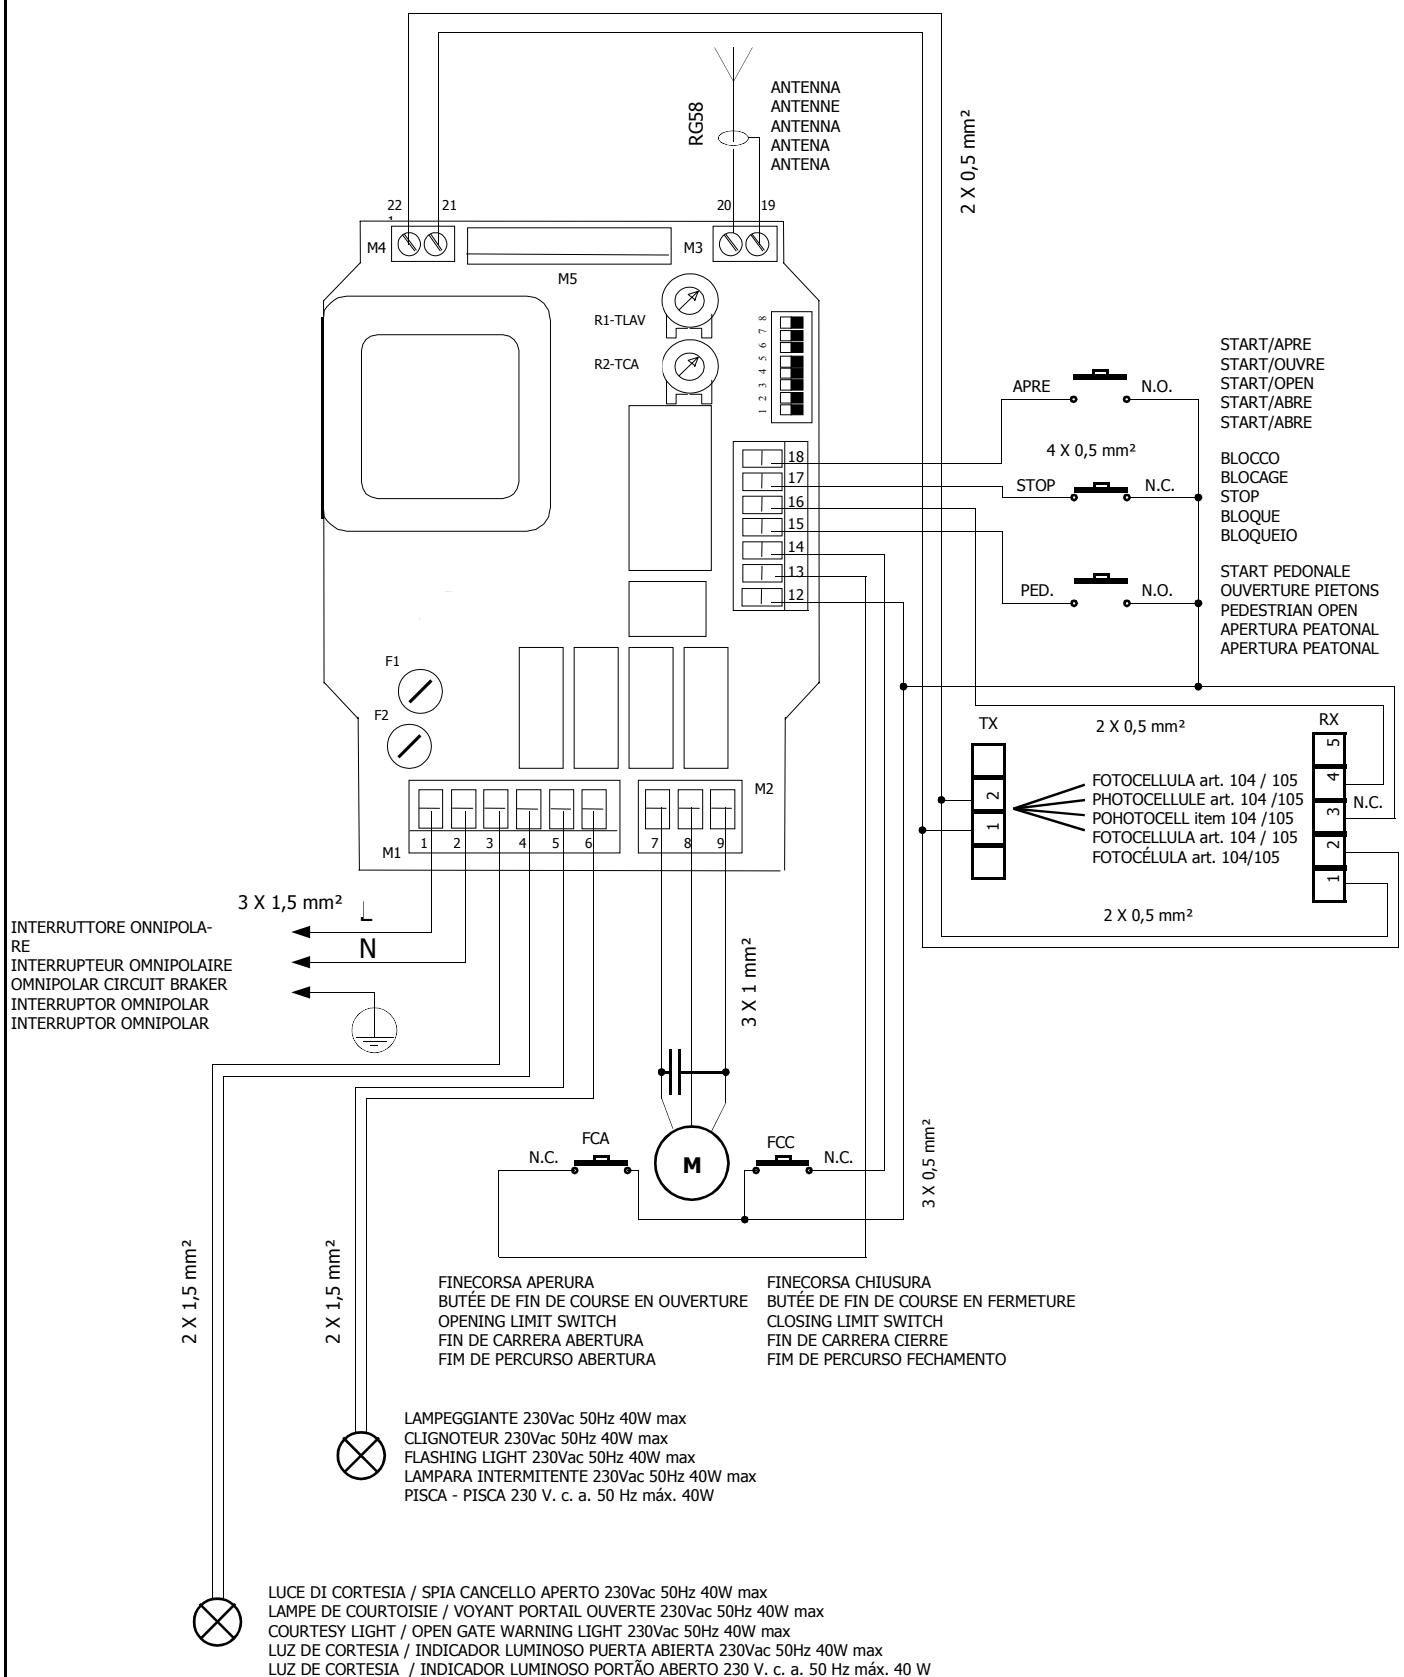

ATTENZIONE: DEA SYSTEM ricorda tuttavia che la scelta, la disposizione e l'installazione di tutti i dispositivi e materiali che compongono l'intera automazione deve avvenire in ottemperanza alle normative vigenti nel paese in cui si effettua l'installazione.

ATTENTION: DEA SYSTEM vous rappelle toutefois que le choix, la disposition et l'installation de tous les dispositifs et de tous les matériaux qui font partie de l'automatisation complète doivent être exécutés conformément aux réglementations en vigueur dans le pays où l'installation sera mise en place.

WARNING: DEA SYSTEM reminds however that the choice and installation of all devices and materials included in the complete automation must respect the legal norms in force in the country where the system is installed.

ATENCIÓN! DEA SYSTEM, no obstante, recuerda que la elección, la disposición y la instalación de todos los dispositivos y materiales que componen el automatismo debe efectuarse en el cumplimiento de las normativas en vigor en el país en el que se efectúa dicha instalación.

ATENÇÃO: Entretanto o DEA SYSTEM lembra que a escolha, a disposição e a instalação de todos os dispositivos e materiais que constituem a inteira automação, devem ser efectuadas a obedecer também as normas em vigor no país onde for instalada.