

Technical Support


☎ 01273 811011


✉ support@paxton.co.uk

Technical help is available: Monday - Friday from 07:00 - 19:00 (GMT)
Saturday from 09:00 - 13:00 (GMT)

Documentation on all Paxton products can be found on our website - <http://www.paxton.co.uk/>

Layout

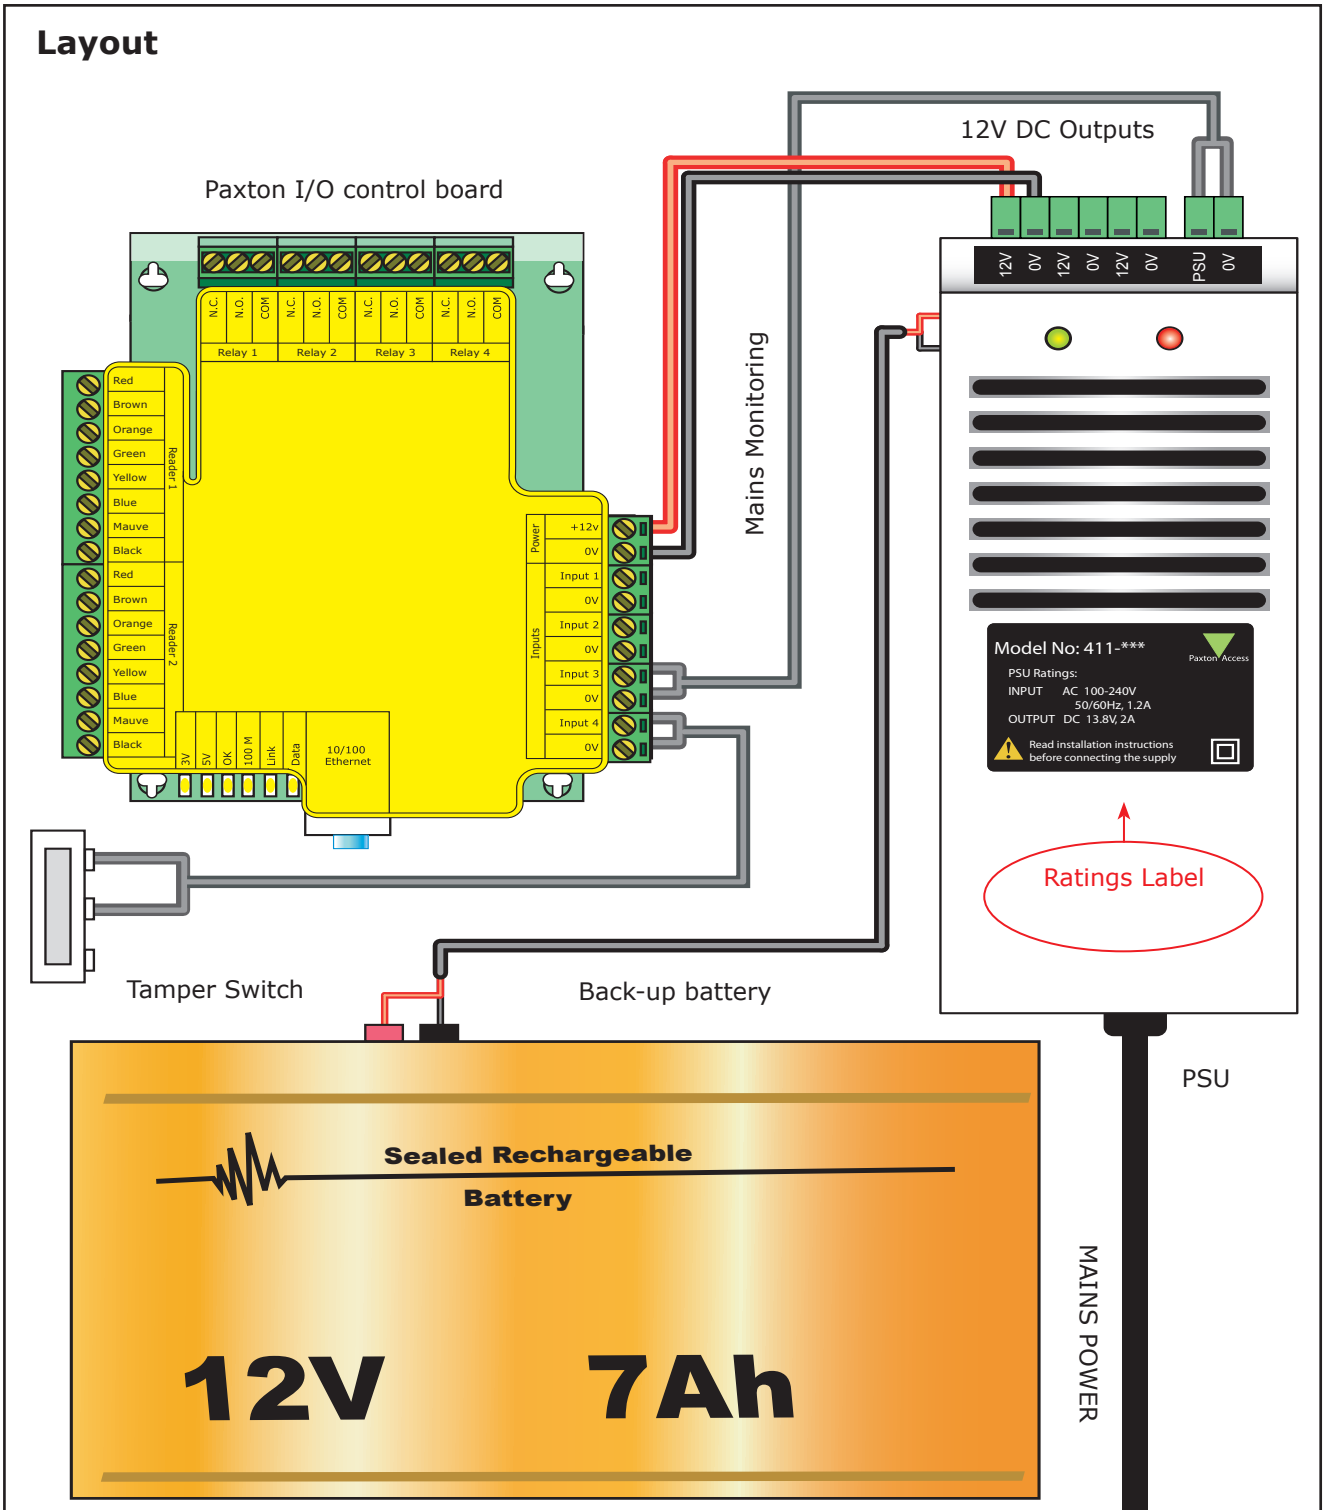

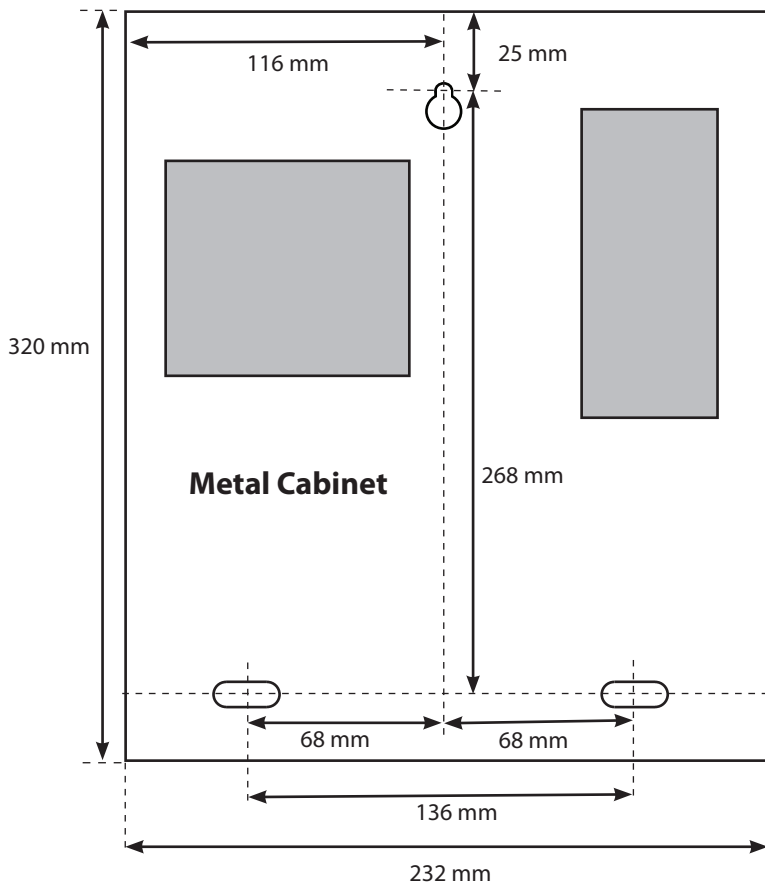

Fitting

1. Screws and wall plugs are provided in a fitting kit. With reference to the diagrams, determine where the top, central mounting position is required and drill a hole suitable for a No 8 wall plug.
2. Tap in one of the wall plugs.
3. Put in one of the long screws, leaving a suitable gap to the wall surface and slide the cabinet over it.
4. Mark the hole positions for the lower 2 screws.
5. Remove the cabinet and drill the additional holes.
6. Tap in the 2 wall plugs and hang the cabinet back onto the top screw.
7. Secure the cabinet with the 2 lower screws.
8. Tighten the top screw.

AC Mains Connection

Cabling


A detachable figure 8 power cable is provided with the unit. This is pre-stripped at one end for connection to a fused spur.

Anchor points are supplied inside the case to secure the incoming mains cable. (cable tidy/ties are provided) There are also 'knock-outs' in the case to allow convenient access for the cable.

Ensure that the supplied compression gland is used when passing the mains cable through any holes in the cabinet.

The power supply is double insulated and requires no additional earth connection.

The PSU's battery function will not work until this unit has first been connected to the mains supply. It is the loss of this supply that switches the unit to battery power.

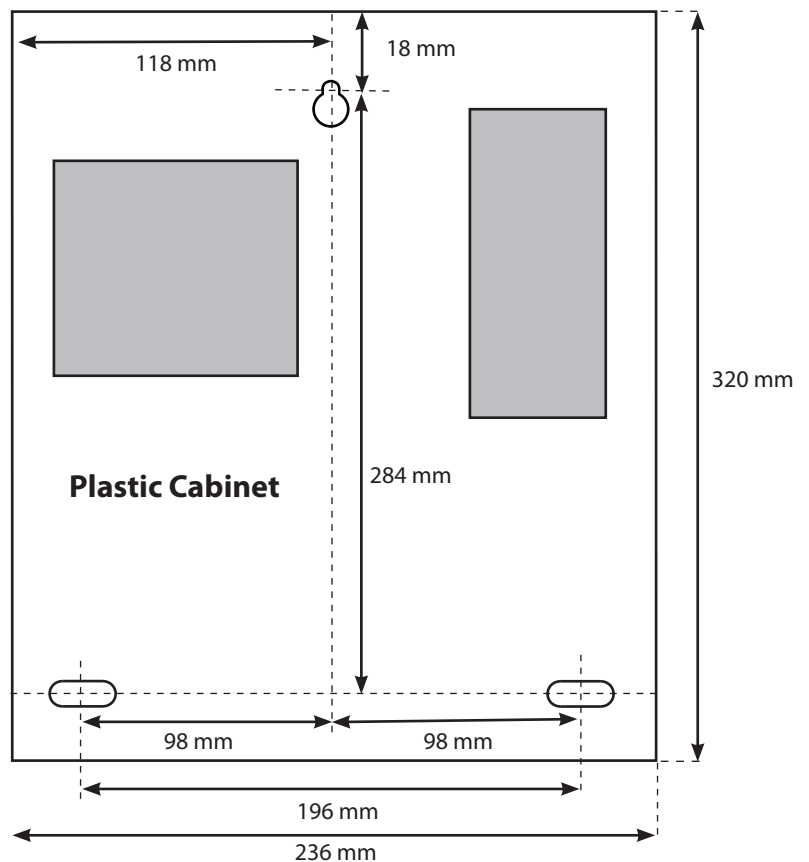

This product is not suitable for retail sale. All warranties are invalid if this product is not installed by a competent person.

Status Lights

| | |
|-------|---|
| Green | This LED is on when the input supply is healthy. |
| Red | This LED is on when the input supply has failed - Power is being supplied by the battery. |

Features

| | |
|---------------------------|---|
| Battery backup | The cabinet can accommodate a 12V / 7Ah battery. |
| Fast/Trickle charge | The battery is continuously charged to keep it at maximum capacity. |
| Deep discharge protection | If battery voltage falls below 9.5V, it will automatically disconnect - Red LED goes out. |
| Mains failure alarm (PSU) | Registers an alarm if the mains power fails when connected to an ACU or I/O board. |
| Tamper alarm | Registers an alarm if the lid is opened when connected to an ACU or I/O board. |

Statement of Conformity

The Low Voltage (LVD) Directive - 2006/95/EC
 The Electro-Magnetic Compatibility (EMC) Directive - 2004/108/EC
 The Restriction of Hazardous Substances (RoHS) Directive - 2002/95/EC



Specifications

| Environment | Min | Max | |
|---|---------|----------|----------|
| Operating temperatures - all items | -20 °C | +45 °C | |
| PSU Electrical | Min | Max | |
| Output voltage | 13V DC | 13.8V DC | |
| Maximum load output current | | 2A | |
| Maximum battery charging current | | 1A | |
| Mains supply voltage | 100V AC | 240V AC | +/- 10% |
| Mains supply current | | 1.2A | |
| Mains supply frequency | 50 Hz | 60 Hz | +/- 3 Hz |
| I/O Electrical | Min | Max | |
| Relay inputs | | 4 | |
| Relay output | | 4 | |
| Relay voltage rating | | 240V AC | |
| Relay current rating | | 13 A | |
| Relay contact isolation | | 4 kV AC | |
| Current | | * 400 mA | |
| *This max value is for when all four relays are energised | | | |
| Dimensions | Width | Height | Depth |
| Metal Cabinet | 232 mm | 320 mm | 80 mm |
| Plastic Cabinet | 236 mm | 320 mm | 80 mm |
| Battery Compartment (Plastic Housing) | 150 mm | 100 mm | 62 mm |

WARNINGS

The following warnings and instructions MUST be adhered to. Read the instructions before installing and powering the equipment. Keep the instructions in a safe place for future reference.

RECEIVING INSPECTION- Remove any traces of packing material from the unit as such debris may create a fire or shock hazard. Unpack the unit with care and inspect for transit damage. If damage is suspected, the unit must not be used or tested, but should be returned to Paxton for investigation and the damage reported to the carrier.

INSTALLATION- Only qualified and trained personnel, familiar with this type of product and who fully understand these instructions should install, connect or test this equipment. There are no user serviceable parts within the PSU unit.

- The equipment is intended for indoor use only in dry locations. This is a Class A product. In a domestic environment this product may cause radio interference in which case the user may be required to take adequate measures.

- The installation must meet National Wiring Regulations and IEC60950-1 standards.

- Disconnect Devices: A readily accessible disconnect device shall be incorporated in the building wiring to include an appropriately rated circuit breaker to disconnect both poles with at least a 3.0 mm contact gap. After switch off, all internal capacitors will discharge to safe levels within 60 seconds under normal conditions. Under fault conditions, charge may be held for much longer and suitable precautions should be taken before handling the unit.

- Protection device: The fusing characteristics of the protection device to be used are T3.15AH250V