

CITOFONI CON POSTO ESTERNO (3+1)


INTERCOMS WITH REMOTE OUTDOOR STATION (3+1)

PARLOPHONES AVEC POSTE DE RUE

(3+1, n°3 conducteurs communs + n°1 conducteur appel)

SPRECHANLAGE MIT EINER AUßENSTELLE (3+1)

WIRING DIAGRAM FOR 8K Kits "n" USERS with Art.8836M-0

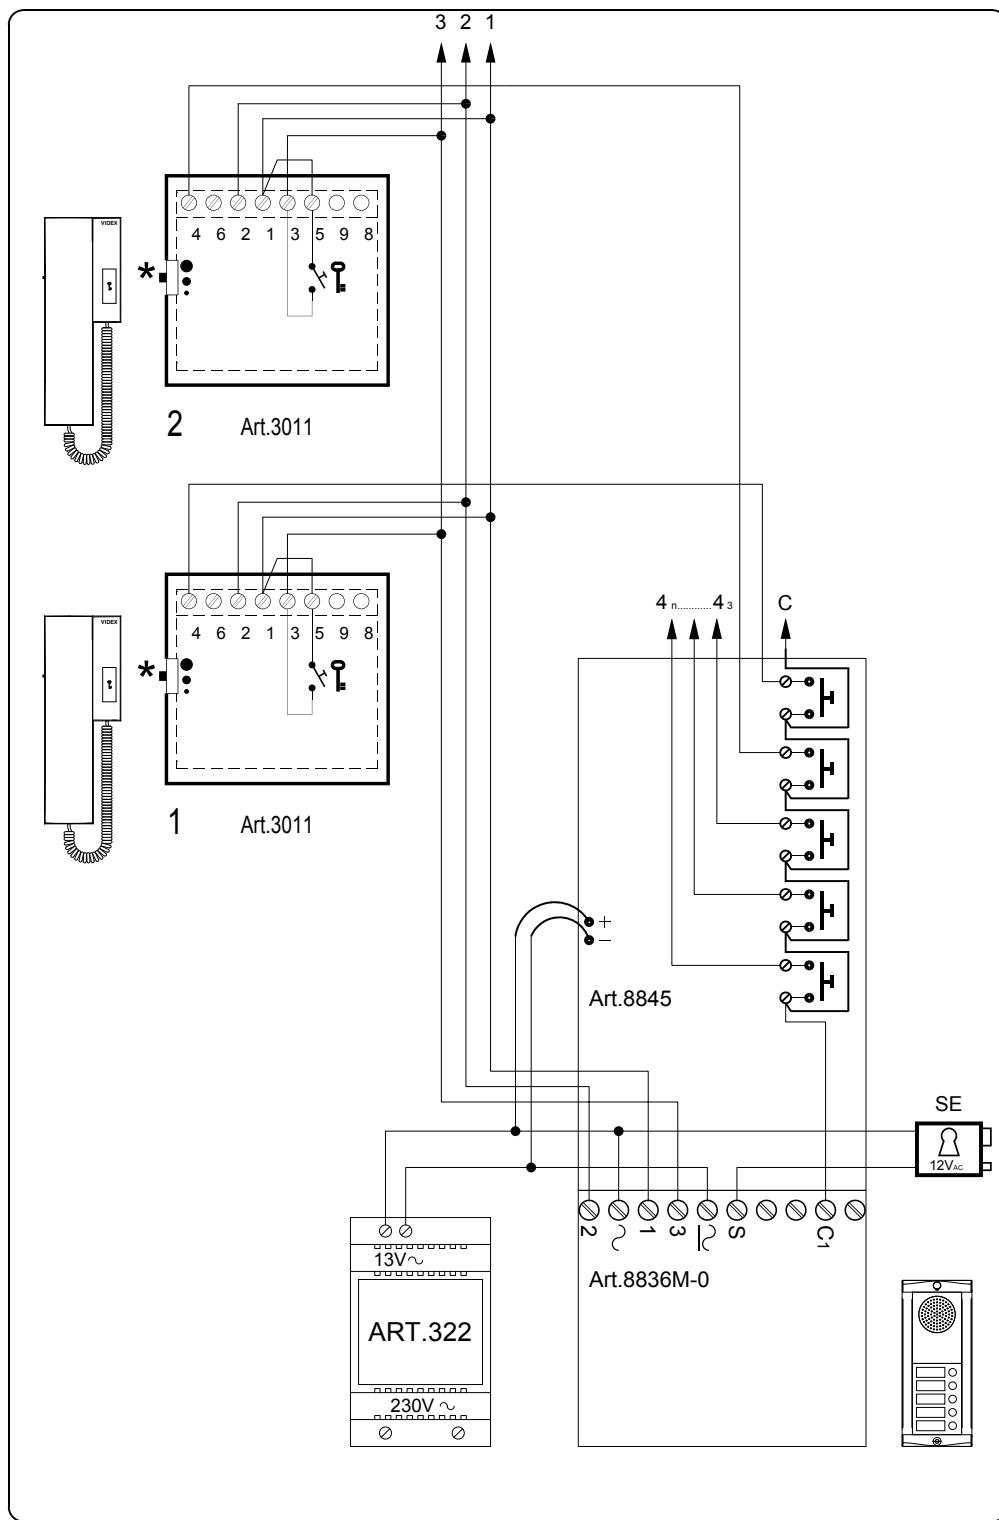

NOTE:

I conduttori in grassetto hanno un diametro minimo di 10/10mm.
The cables which are heavily outlined have a minimum diameter of 10/10mm.

Les conducteurs en gras ont un diamètre minimum de 10/10mm.
Stark gezeichnete Linien müssen einen Leitungsquerschnitt von mindestens 1mm. Ø aufweisen

Art.3011

- Citofono
- Intercom
- Innenstelle
- Poste d'appartement
- Teléfono

ART.322

- Alimentatore
- Power supply
- Netzeil
- Alimentation
- Alimentador

ART.8836M-0..

- Modulo portiere elettrico
- Speaker unit module
- Aussenstelle mit Sprecheinheit
- Groupe phonie
- Unidad de habla/Botonera con parlante

ART.8843...8845..

- Modulo pulsanti
- Extension front panel module
- Tastenmodul
- Module avec boutons d'appel
- Modulo de ampliacion

*

- Regolazione volume della nota elettronica (3 livelli).
- Call tone volume control (3 Levels).
- Régulation du volume de l'appel électronique (sur 3 niveaux).
- Lautstärkeregulierung des elektronischen Rufs (auf 3 Niveaus).
- Control de volumen del tono electrónico (3 niveles).
- Controle de volume (3 níveis) de chamada electrónica.

We recommend

This equipment is installed by a Competent Electrician, Security or Communications Engineer



VIDEX ELECTRONICS S.p.A.

COD.FILE: 8K-N


DENOMINAZIONE: 8K Kit "n" Users with Art.8836M-0

DATA: 13/07/2010

CITOFONI CON POSTO ESTERNO (3+1) INTERCOMS WITH REMOTE OUTDOOR STATION (3+1) PARLOPHONES AVEC POSTE DE RUE

(3+1, n°3 conducteurs communs + n°1 conducteur appel)
SPRECHANLAGE MIT EINER AUßenSTELLE (3+1)

WIRING DIAGRAM FOR 8K Kits "n" USERS with Art.8836M-1

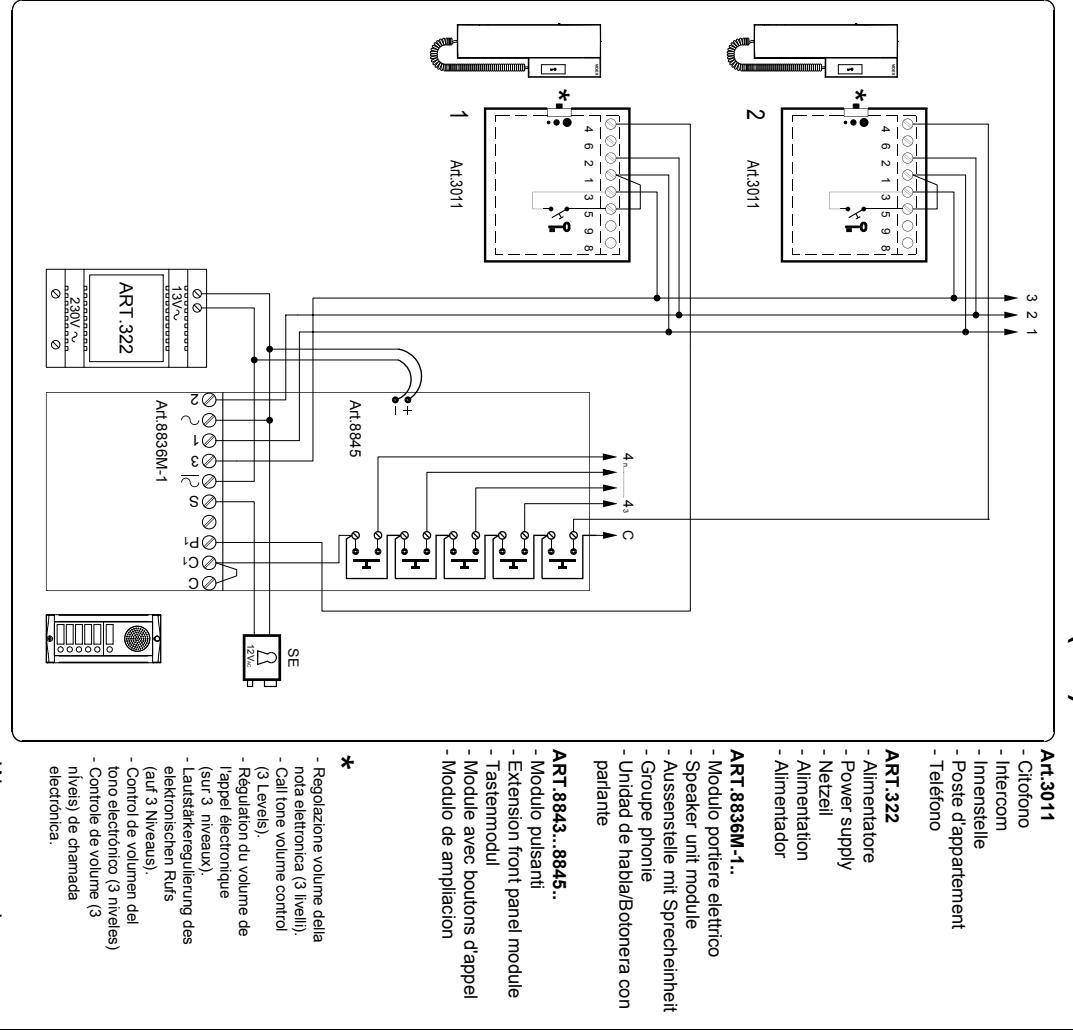

NOTE:
I conduttori in grassetto hanno un diametro minimo di 10/10mm.

The cables which are heavily outlined have a minimum diameter of 10/10mm.

Les conducteurs en gras ont un diamètre minimum de 10/10mm.


Stark gezeichnete Linien müssen einen Leitungsquerschnitt von mindestens 1mm. Ø aufweisen.

We recommend

This equipment
is installed by a
Competent Electrician,

Security or
Communications Engineer

WIRING DIAGRAM FOR 8K Kits "n" USERS with Art.8836M-2

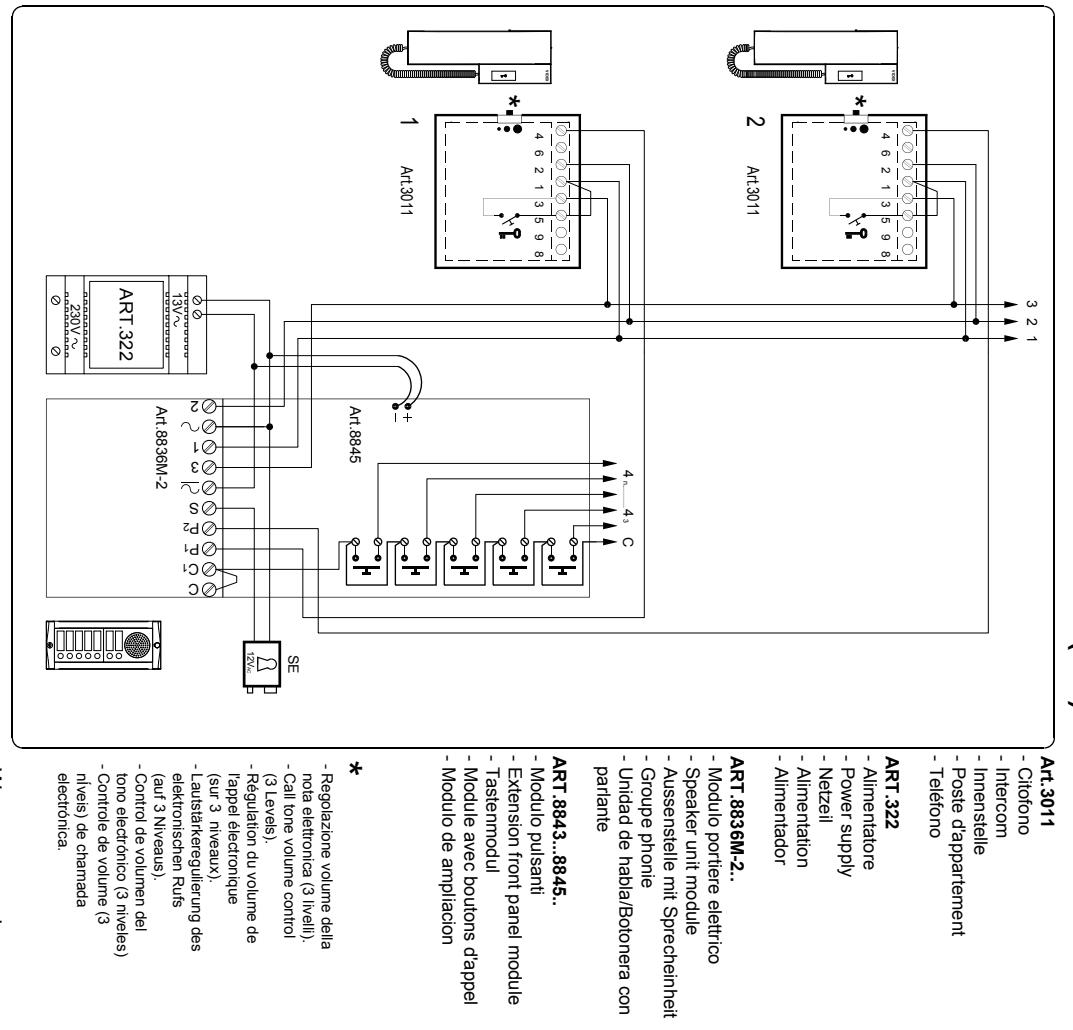

NOTE:
I conduttori in grassetto hanno un diametro minimo di 10/10mm.

The cables which are heavily outlined have a minimum diameter of 10/10mm.

Les conducteurs en gras ont un diamètre minimum de 10/10mm.

Stark gezeichnete Linien müssen einen Leitungsquerschnitt von mindestens 1mm. Ø aufweisen.

We recommend

This equipment
is installed by a
Competent Electrician,

Security or
Communications Engineer